



9905-001 (STANDARD MODEL WITHOUT VOLTAGE MATCHING)

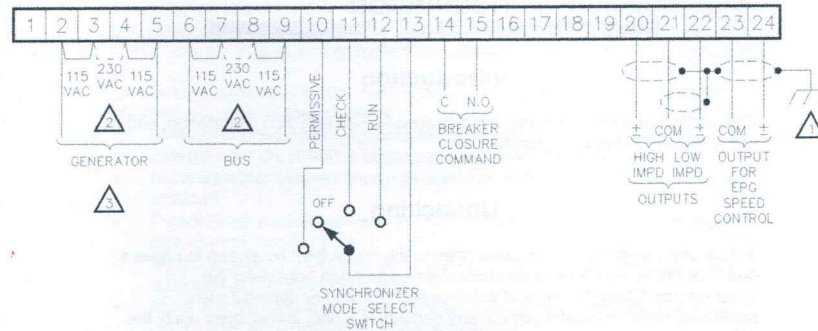

9905-002 (STANDARD MODEL WITH VOLTAGE MATCHING)

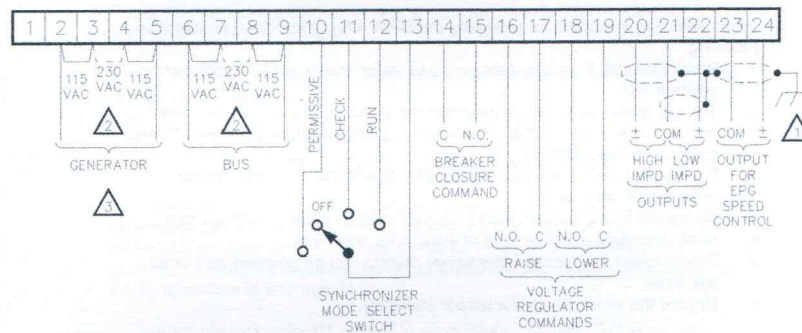

NOTES:

- 1 SHIELDED WIRES TO BE TWISTED PAIRS WITH SHIELD GROUNDED AT ELECTRIC CONTROL END ONLY.
- 2 FOR 115 VAC OPERATION JUMPER TERMINALS 2&3, 4&5, 6&7, AND 8&9. FOR 230 VAC OPERATION JUMPER TERMINALS 3&4 AND 7&8.
- 3 IF A DEAD-BUS RELAY IS USED TO CLOSE THE GENERATOR BREAKER, THE MODE SELECT SWITCH MUST BE IN THE OFF POSITION UNTIL THE SYNCHRONIZER CAN CLOSE TO A LIVE BUS.

823-151
91-04-04 MOL

Figure 1-4. Plant Wiring Diagram